



LEAVE A CLEARANCE OF AT LEAST 12" FROM OTHER EQUIPMENT TO ALLOW FOR THE COVER TO BE REMOVED FOR MAINTENANCE.

12"

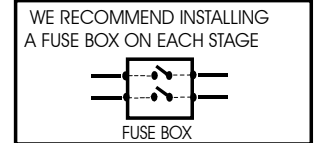

WIRE GND


GND } CONTROL
L2 (N) } POWER SUPPLY
L1 } 230 VAC (115 VAC)

GND } STAGE 1 & 2
L1 } POWER SUPPLY
L2 (N) } 230 VAC (115 VAC)






NOTES

1. INSTALLATION OF A GOOD QUALITY ALARM SYSTEM IS STRONGLY ADVISED TO WARN OF POWER FAILURES AND HIGH/LOW TEMPERATURES.
2. PROVIDE SURGE PROTECTION (TO INCLUDE PROTECTION FROM LIGHTNING) FROM POWER SUPPLY TO CONTROL AND FROM CONTROL TO OUTPUT EXTENDED PROBE. CONSULT A CERTIFIED ELECTRICIAN FOR SPECIFIC RECOMMENDATIONS.
3. SAME PHASES MUST BE USED TO POWER VARIABLE FANS AND CONTROLS ON 3 PHASES POWER.

DO NOT DRILL THE SIDES OF THE UNIT CONTROL. USE AVAILABLE KNOCK OUTS AT THE BOTTOM OF THE UNIT.

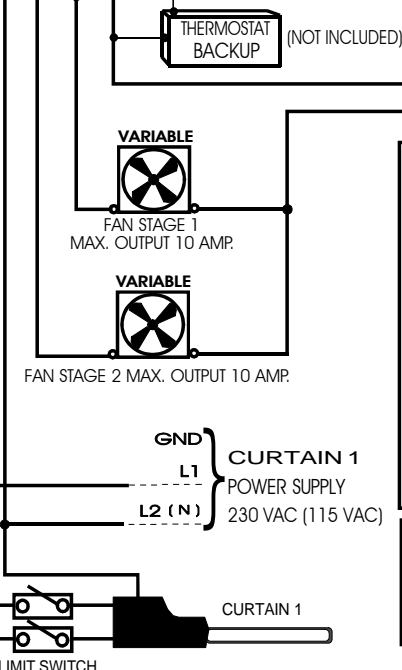

Curtain 2:
Refer to curtain 1

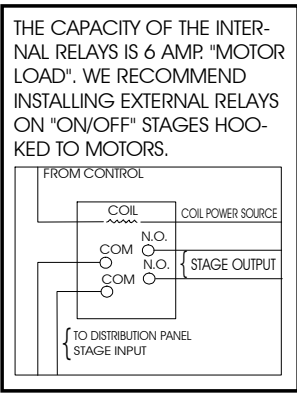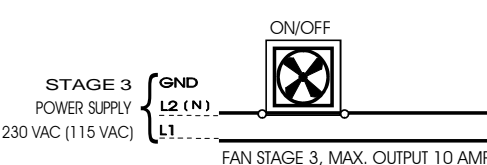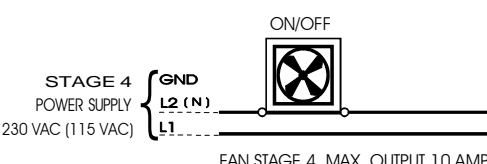

WIRING DIAGRAM	
OVATION 224	
#891-00041	Rev.00